


BENSTEAD PLUGS
5-28-13

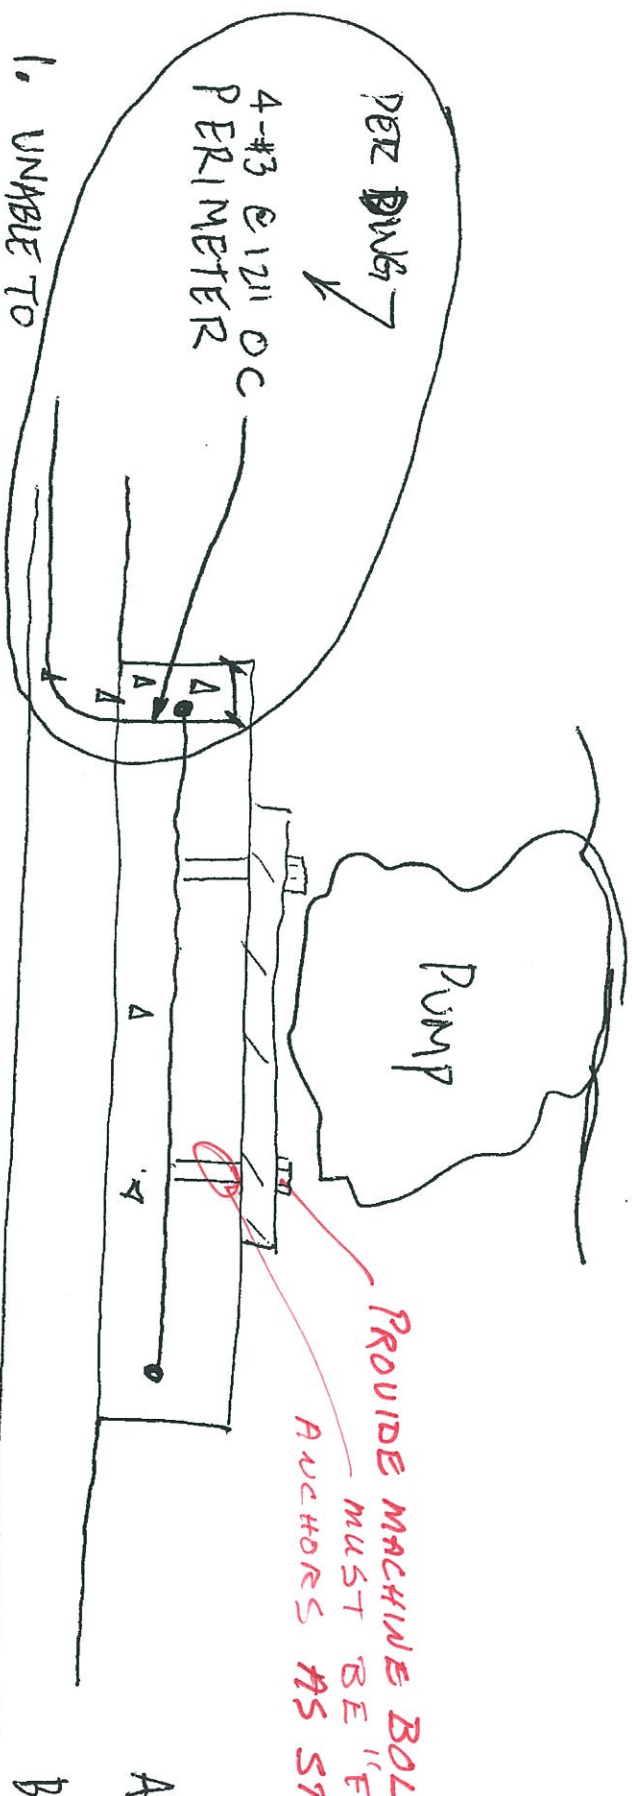


PROVIDE MACHINE BOLT.
MUST BE "FEMALE"
ANCHORS AS SPECIFIED

1. UNABLE TO
DO BECAUSE
OF ONLY 6" FLOOR
& then Room (Sump) Below

↓ Sump

2. CAN IT BE ACCEPTABLE TO
Place Rebar 4-#3 @ 12" OC
but in fashion shown below:

NO

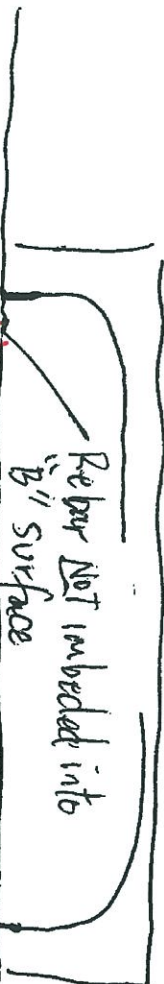

MIN. 3" EMBEDMENT w/ HILT
44-150.

<input type="checkbox"/> REVIEWED <input checked="" type="checkbox"/> FURNISH AS CORRECTED <input type="checkbox"/> RECEIVED FOR RECORD	<input type="checkbox"/> REVISE & RESUBMIT <input type="checkbox"/> REJECTED <input type="checkbox"/> RETURNED WITHOUT REVIEW
This review is for general conformance only with design intent and general compliance with the information given in the Contract Documents. Corrections or comments made during this review do not relieve contractor from compliance with all requirements of the Contract Documents. Contractor is responsible for: dimensions to be confirmed and coordinated at the jobsite; information that pertains to the fabrication processes or to the means, methods, techniques, sequences and procedures of construction; coordination of the Work with that of all other trades; and for performing all work in a safe and satisfactory manner.	
Date: 5-28-13 By: <i>JB</i>	